

TYPICAL COMPRESSOR PERFORMANCE

[409] C21

HFHR = 0.500

RATIO OF SPECIFIC HEATS 1.307

SPECIFIC GRAVITY 0.601

SUCTION TEMPERATURE 60.0 F

SUCTION PRESSURE 533.00 PSIA

Solar® Turbines

A Caterpillar Company

CONTROL NO.

I-32511 SHT.1

ISSUE DATE

14 MAY 2007

ENGINEER

JEFF LOTTON


SUG

HP REPLACEMENT

HO06-0058

CENTAUR50L-6200S

C40-1P

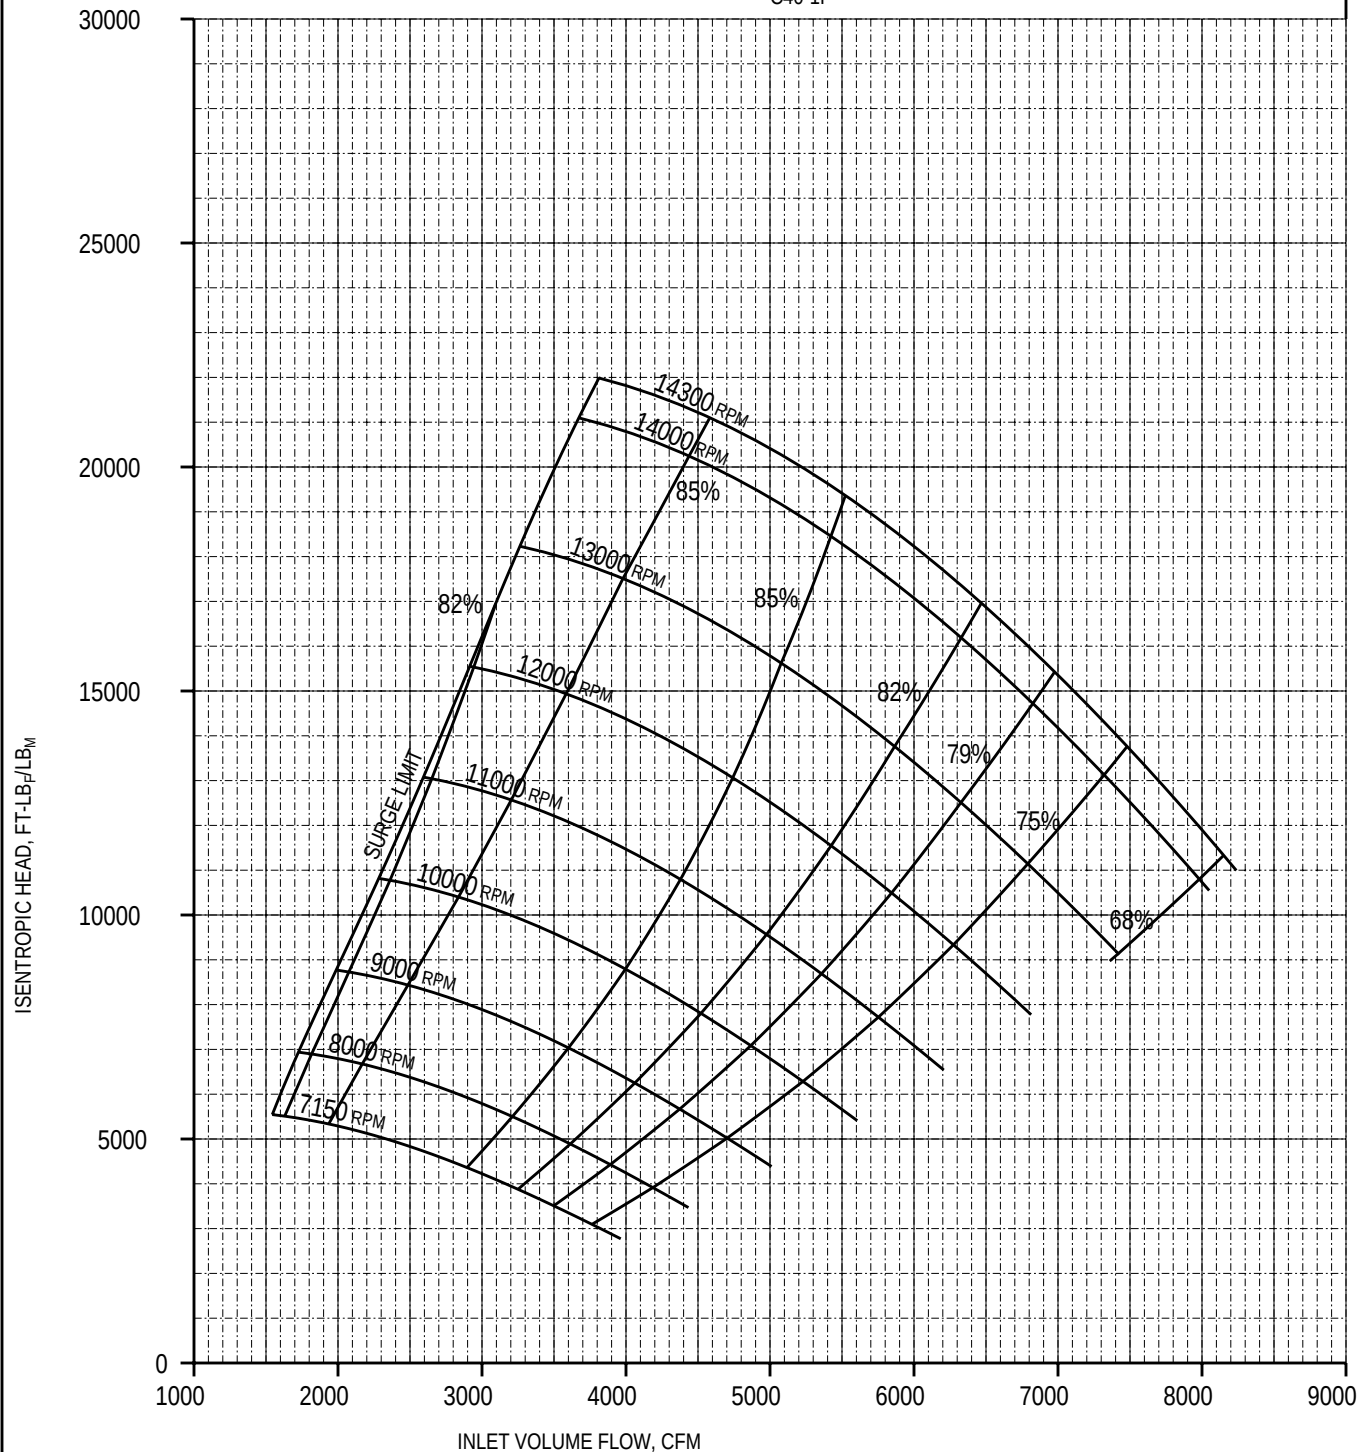

TYPICAL COMPRESSOR PERFORMANCE

[409] C21

HFHR = 0.500

RATIO OF SPECIFIC HEATS 1.307

SPECIFIC GRAVITY 0.601

SUCTION TEMPERATURE 60.0 F

SUCTION PRESSURE 533.00 PSIA

Solar® Turbines

A Caterpillar Company

CONTROL NO.

I-32511 SHT.2

ISSUE DATE

14 MAY 2007

ENGINEER

JEFF LOTTON


SUG

HP REPLACEMENT

HO06-0058

CENTAUR50L-6200S

C40-1P

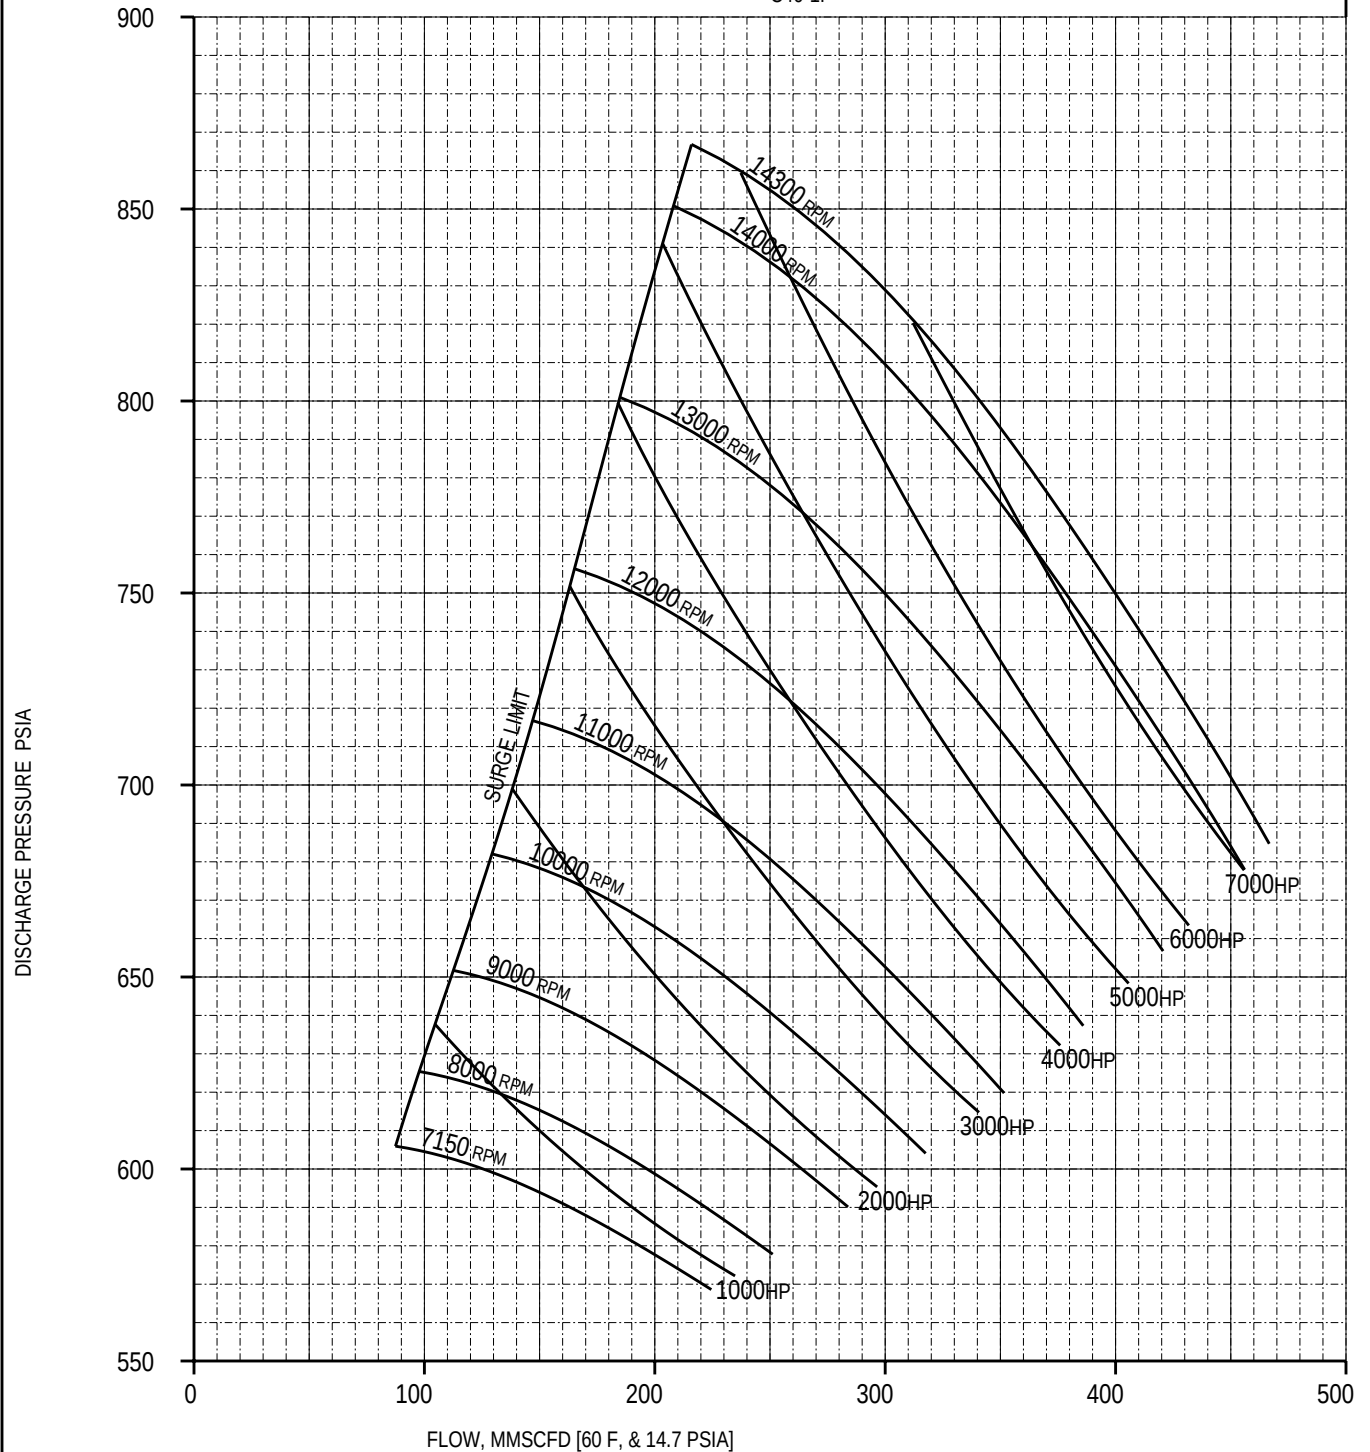

TYPICAL COMPRESSOR PERFORMANCE

[409] C21

HFHR = 0.500

RATIO OF SPECIFIC HEATS 1.307

SPECIFIC GRAVITY 0.601

SUCTION TEMPERATURE 60.0 F

SUCTION PRESSURE 533.00 PSIA

Solar Turbines

A Caterpillar Company

CONTROL NO.

I-32511 SHT.3

ISSUE DATE

14 MAY 2007

ENGINEER

JEFF LOTTON

SUG

HP REPLACEMENT

HO06-0058

CENTAUR50L-6200S

C40-1P

